


Odouriser • Inertech

designed for use with

FSL Inert Clean Agent Gaseous Suppression Systems

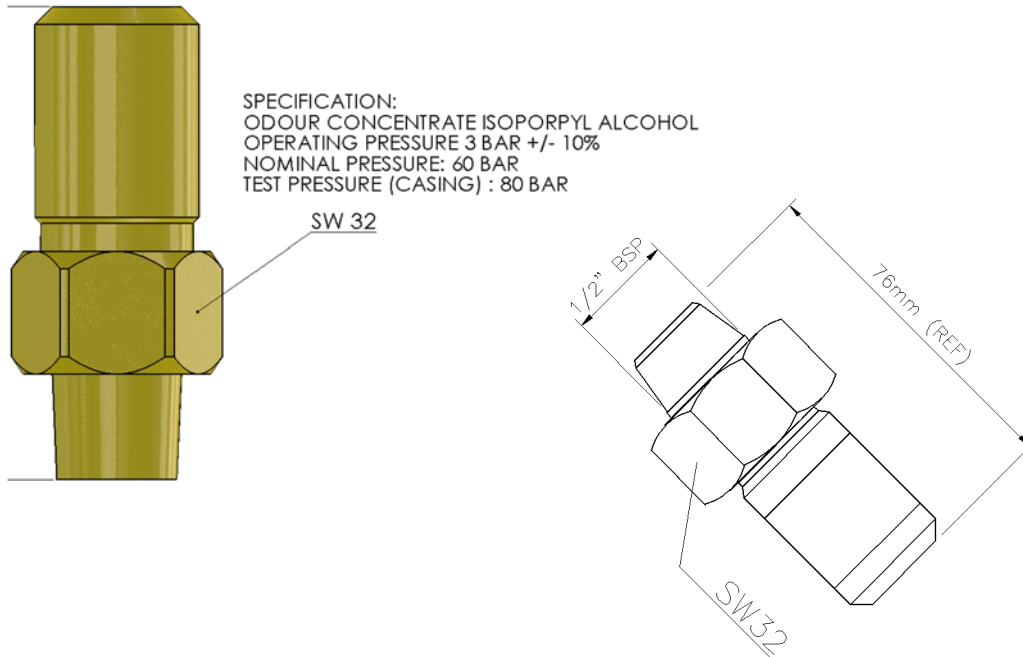

Odouriser and specification (top left), odouriser in position it should be fixed in (bottom right)

The Odouriser must be fitted into the discharge pipework so the outlet is uppermost. Fit at 45° as shown above, it can be fitted into a tee piece at 45° for convenience.

The Odourising device adds concentrated odour fluid to gaseous fire extinguishing systems.

Upon discharge of the extinguishant, the bursting disc will be ruptured, adding the odour fluid to the flowing extinguishant.

Replace after system discharge

Locate Downstream of any selector valves

Properties

| | |
|------------------|-----------------------|
| Weight | 0.283kg |
| Material | Brass |
| Filling Quantity | 10±0.5cm ³ |