


### Actuation Options • FSL Chemical gas systems

*Designed for use with*

### Clean Agent Chemical Gaseous Suppression Systems

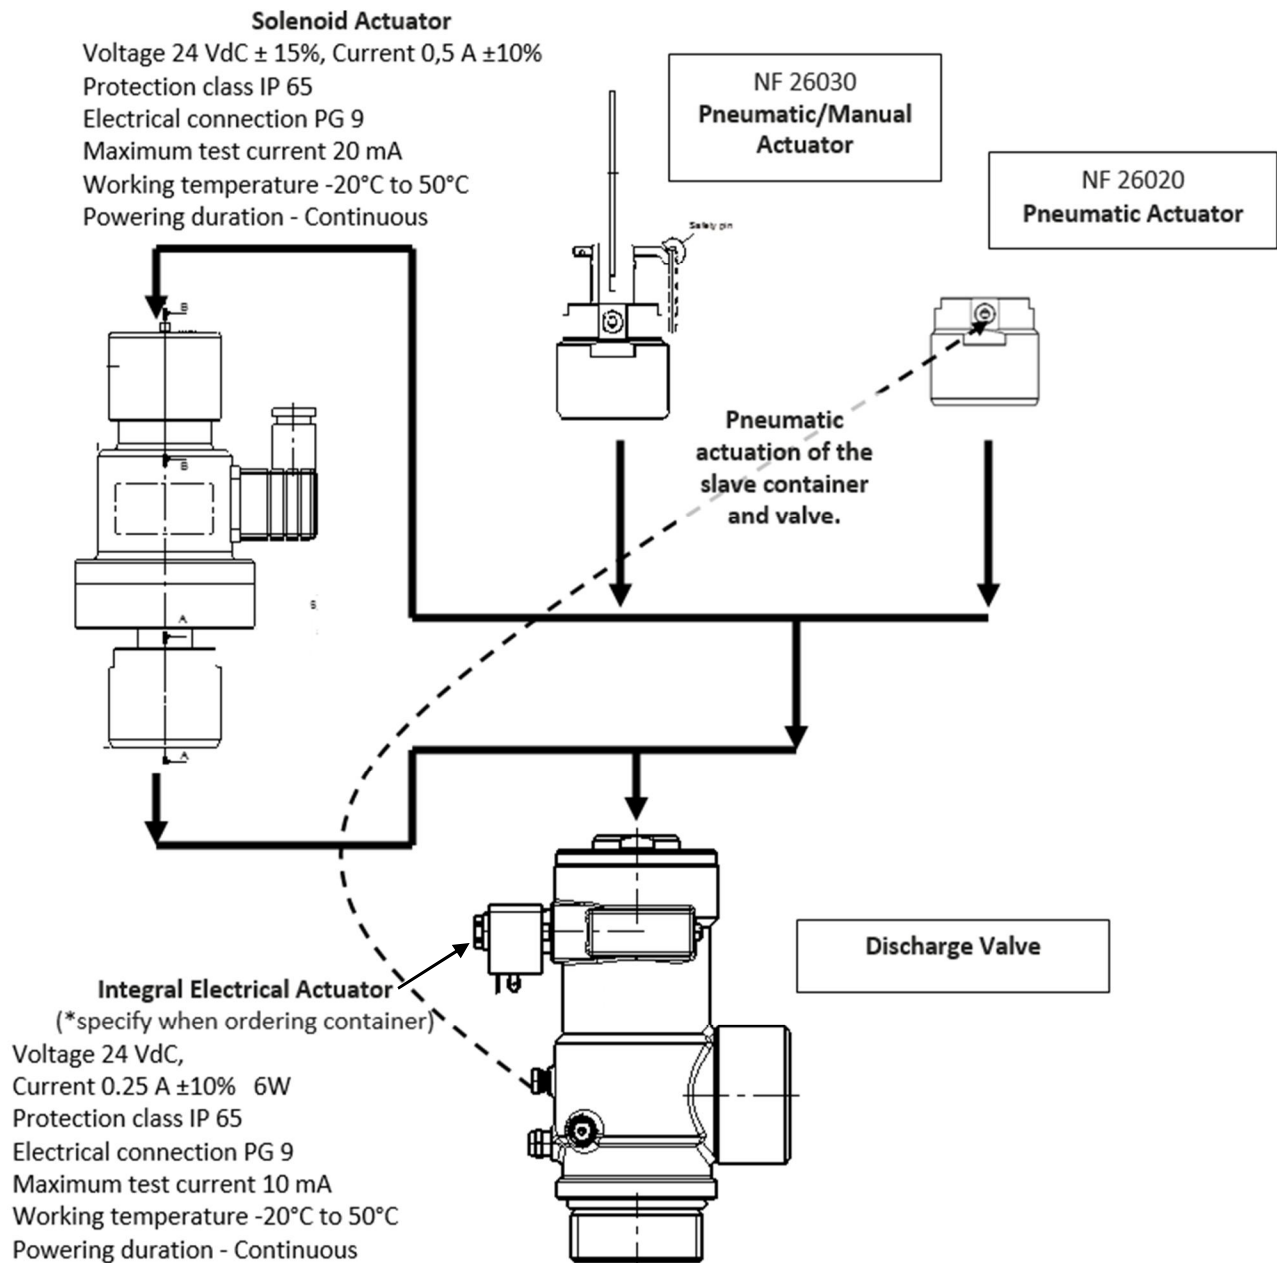

\* Note: Integral Solenoid cannot be fitted after the container is filled.

#### Life of Actuators

The life of all actuators is indefinite.

Recommended maintenance:

- Visually check for corrosion and damage every 6 months
- Replace Integral Solenoid core every 10 years.